

Must Remain On Site

PROJECT DESCRIPTION:

SCOPE OF WORK: LOWER 26 SPRINKLERS TO ACCOMODATE NEW DROPPED CEILING, REMOVE 9 SPRINKLERS NO LONGER NEEDED DUE TO ADDITION/DELETION OF WALLS, AND MOVE 1 SPRINKLER THAT IS TOO CLOSE TO A WALL.

PARCEL #: 9195750000
PROPERTY OWNER: BEL LAGO CONDOS LLC
19805 NE116TH ST PMB 7133
KIRKLAND, WA 98034

SYSTEM DESIGN NOTES:

DESIGN WAS DESIGNED IN ACCORDANCE WITH 2007 NFPA 13.


MAXIMUM SPACING OF 256 SQFT (16' X 16') HAS NOT BEEN EXCEEDED AND THE MOST HYDRAULICALLY REMOTE AREA HAS NOT BEEN AFFECTED THEREFORE NO NEW HYDRAULIC CALCULATIONS HAVE BEEN SUBMITTED.

MODIFICATIONS THAT CANNOT BE ISOLATED, SUCH AS RELOCATED DROPS, DO NOT REQUIRE TESTING IN EXCESS OF NORMAL SYSTEM WORKING PRESSURE PER NFPA 13 24.2.1.6.


BATHROOMS NOT EXCEEDING 55 SQFT DO NOT REQUIRE SPRINKLERS PER 8.15.8.1.1.

CLOSETS UNDER 13 SQFT DO NOT REQUIRE SPRINKLERS PER 21.20.19.2.1.

A COVER INSPECTION IS REQUIRED PRIOR TO CONCEALMENT OF SPRINKLER PIPING.

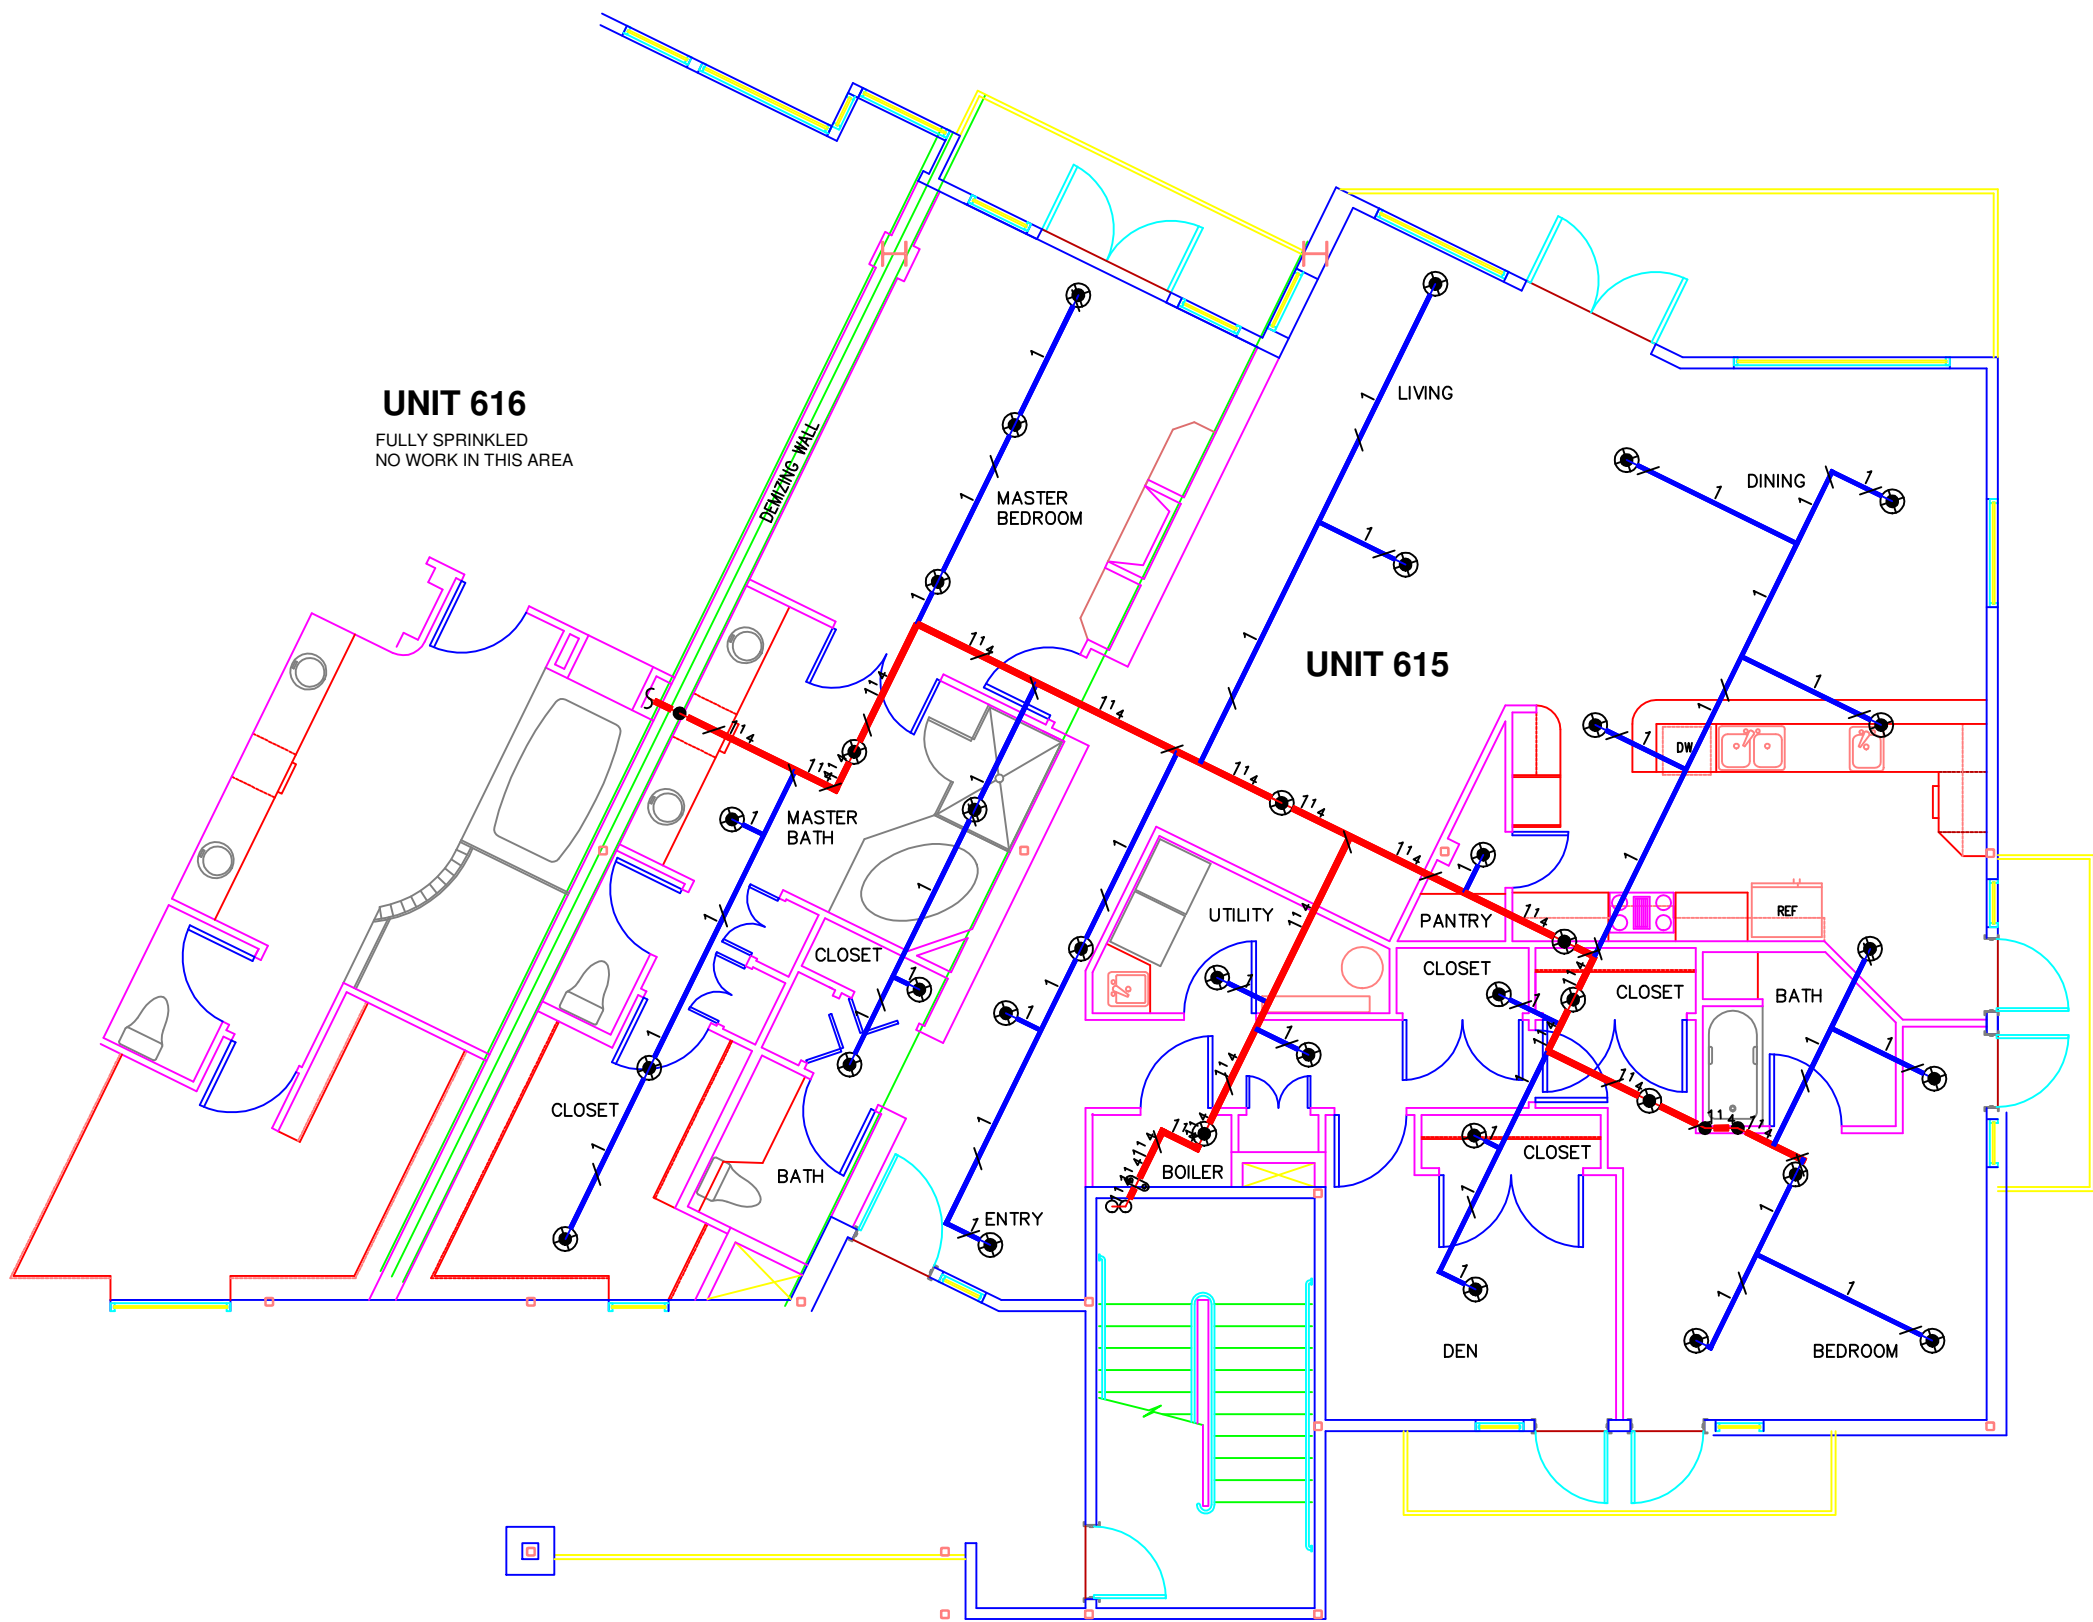

Original Unit 615 Plan
Scale : 1/8"=1'0"

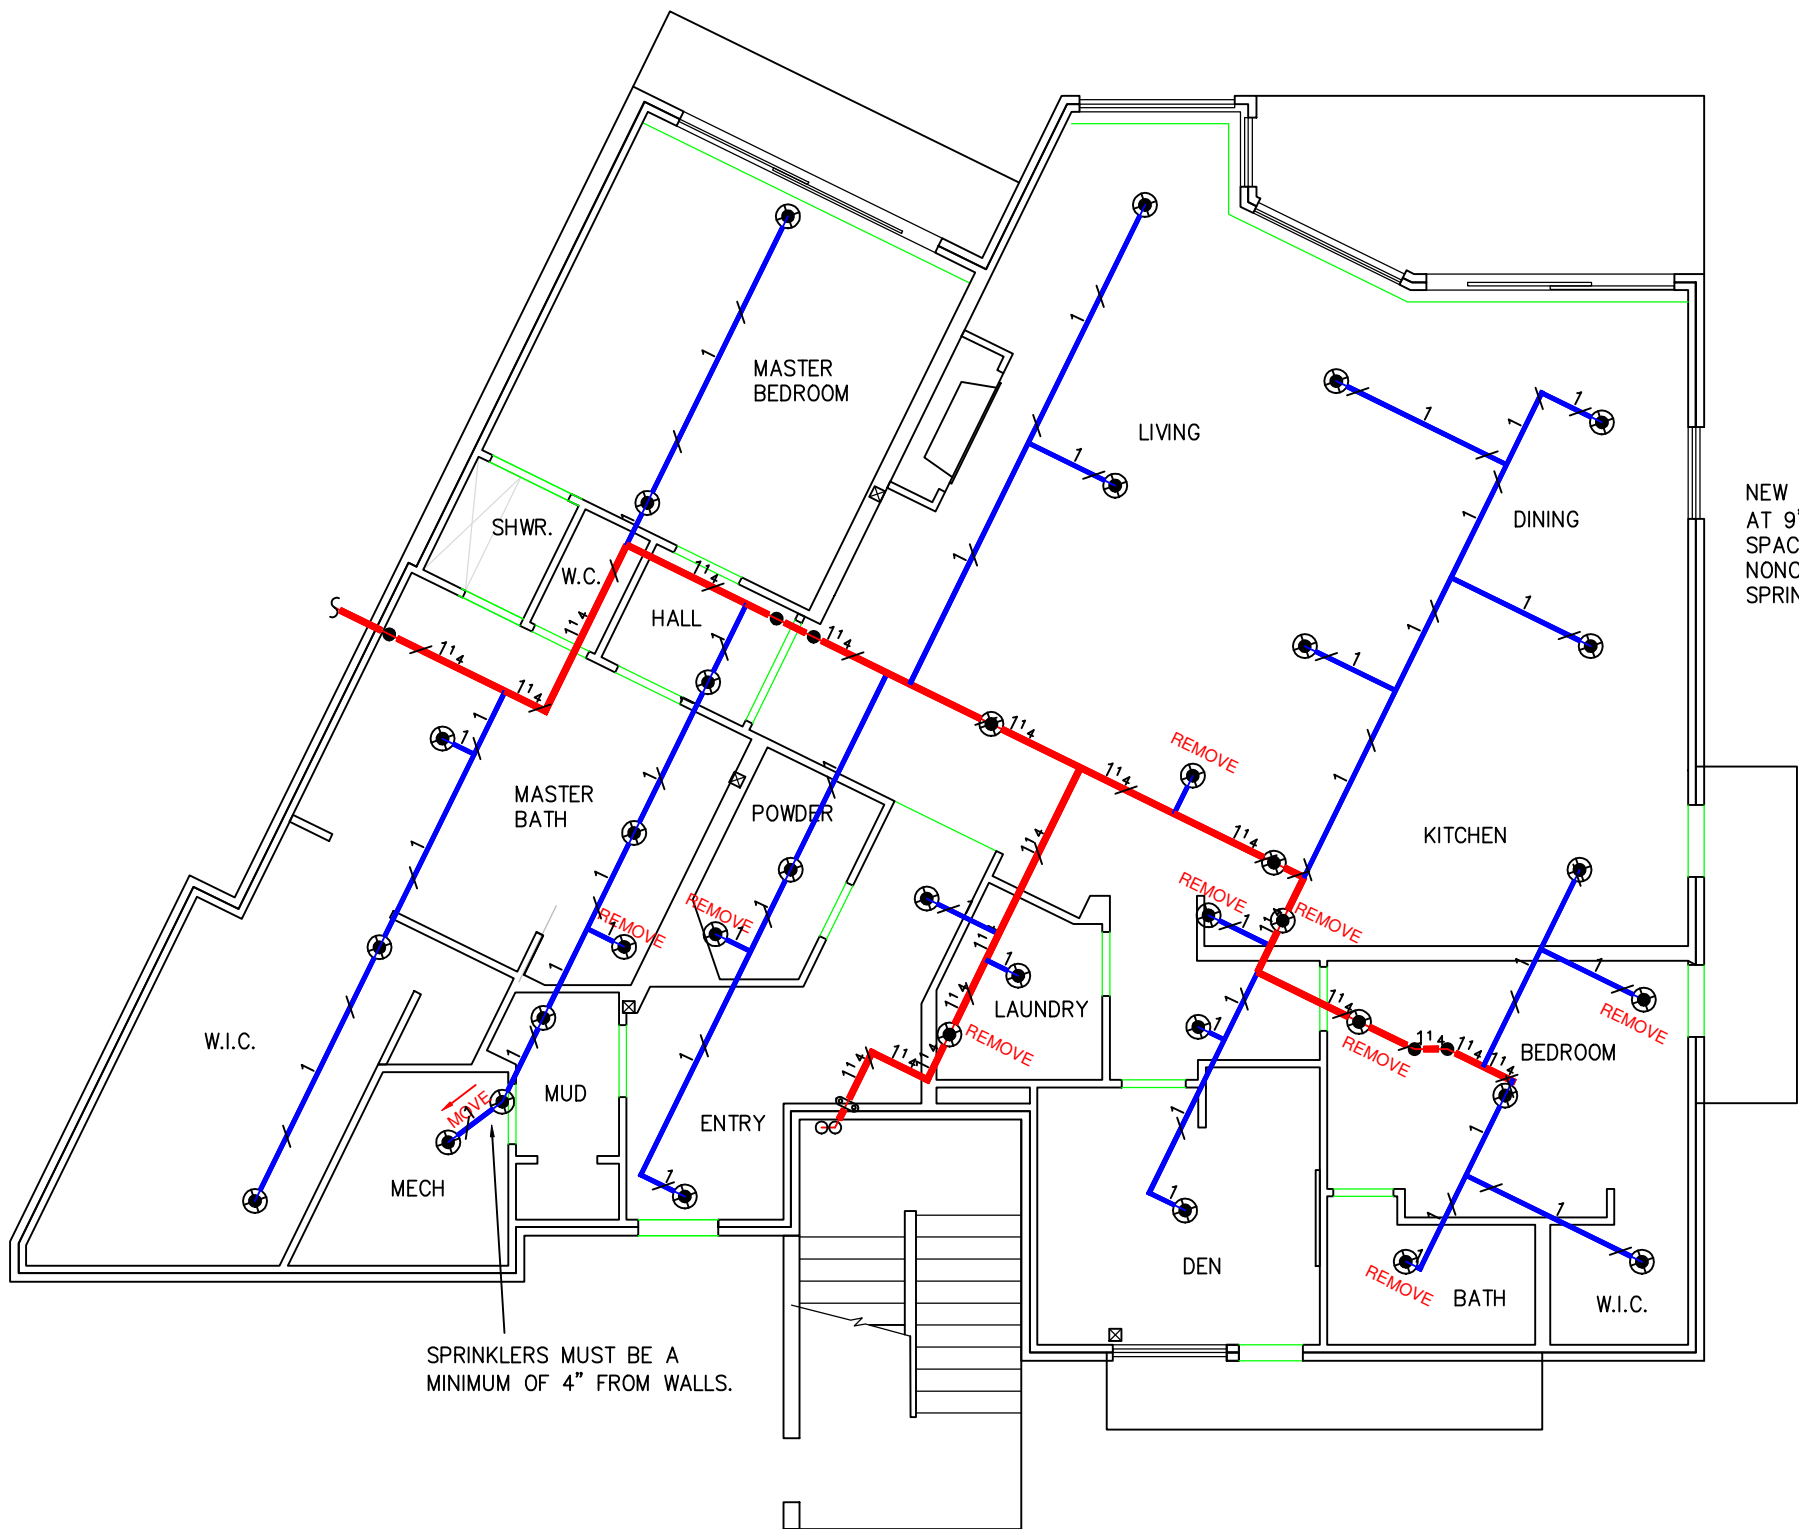


New Unit 615 Plan
Scale : 1/8"=1'0"

SYM	QTY.	POSITION	FINISH	TEMP	K	NPT	SIN	MFG.	MODEL#
●	36	PENDENT	WHITE	165	4.30	1/2"	RA0612	RELIABLE	RFC

JOB #		F14026	
PERMIT NO.	CONTRACT NO.	APPROVAL	DRAWN BY
DATE	SCALE	AS NOTED	JEFF MOEN
10/8/2014	10/8/2014	10/8/2014	10/8/2014
REVISED	1	OF 1	

Bel Lago Condos Unit 615
9123 NE Juanita Dr
Kirkland, WA 98034

Wolfe Fire Protection, Inc.
17321 Tye St SE # B
Monroe, WA 98272
CONTRACTOR # WOLFEFP906DD
360-794-7926

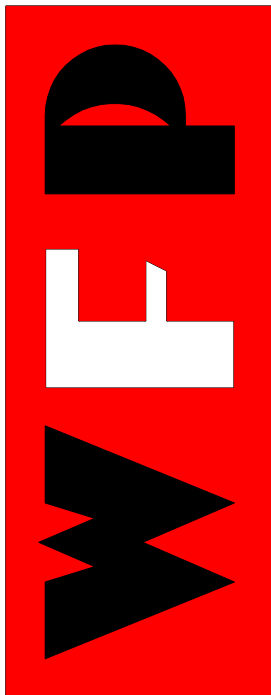

JChappell

10/14/2014

